


DUALPULSE

BI-DIRECTIONAL INSERTION FLOW TRANSDUCER

INSTRUCTION MANUAL

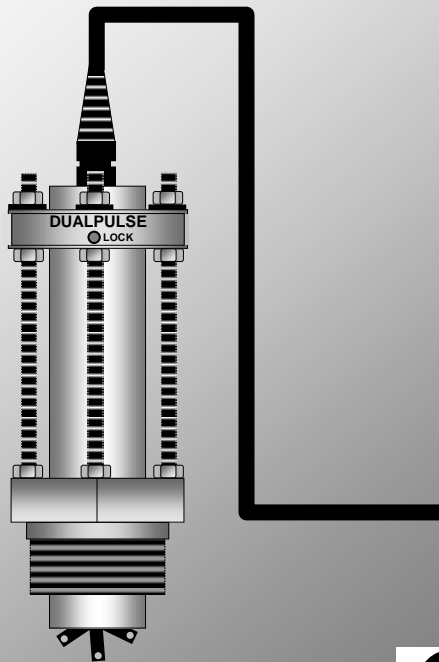

1.1 General arrangement

Thank you for purchasing a Dualpulse Flowmeter. It is important that you read this manual to gain a full understanding of the capability and operational aspects of the equipment you are about to install.

This information is provided only to assist in the installation of the product and does not diminish your obligation to read the manual.

1. Select a location that meets the requirements as illustrated on the guideline sheet (yellow pages located in the center of this manual). An ideal installation would provide for 25 diameters of straight pipe upstream from the meter and 10 diameters downstream.

You will also need to know the pipe internal diameter (NB) and pipe wall thickness for calculation of the insertion depth. (*refer page 5.*) Non ideal installations may require in-situ calibration (*refer to the factory for details*).

2. After screwing the Dualpulse in place ensure the flow alignment mark located on the top positioning collar of the meter aligns with the flow in the pipe (*refer page 5*). This ensures the paddle is correctly aligned to the flow.

Note. the meter is bi-directional so a flow direction arrow is not provided.

3. Calculate and adjust the height of the Dualpulse (*refer page 5*).

4. Electrical Installation depends on the model you have purchased.

If the dualpulse is fitted or supplied with a receiving instrument such as a totaliser or rate totaliser please refer to the appropriate manual and Page 10 of this manual. For pulse output meters, select the appropriate output and wire to your receiving device. (*refer pages 7 to 9*).

5. Calculate the Dualpulse K (*scale*) factor to suit the installation. For ideal installations refer to page 11 or 12 or 13 of the Dualpulse Manual. For non ideal installations the K-factor may be calculated by performing an in-situ calibration. Enter the appropriate K-factor into your receiving instrument.

CONTENTS	PAGE
1.0 INTRODUCTION	
1.1 General arrangement	2
1.2 Overview	3
1.3 Operating principal	3
1.4 Specifications	3
2.0 INSTALLATION	
2.1 Meter location	4
2.2 Meter installation & orientation	4
2.3 Height adjustment	5
2.4 Flow direction orientation	5
2.5 Hot tap installations	6
3.0 ELECTRICAL CONNECTIONS	
3.1 Standard outputs	7
3.2 Optional Reed switch output	7
3.3 Instrument cable installation requirements	8
3.4 Pulse output selection (standard outputs)	8
3.5 QP Quadrature pulse output option	9
3.6 Bi-directional flow using QP option	9
3.7 Connection to family instruments	10
4.0 CALIBRATION (K- factor for meter)	
4.1 K-factors for common pipe ID sizes <575mm	11
4.2 K-factors for large pipe ID >460mm	11
4.3 Calculating K-factors (<i>metric units – litres or M3</i>)	12
4.4 Calculating K-factors (<i>US gallons</i>)	13

1.1 General arrangement

Thank you for purchasing a Dualpulse Flowmeter. It is important that you read this manual to gain a full understanding of the capability and operational aspects of the equipment you are about to install.

This information is provided only to assist in the installation of the product and does not diminish your obligation to read the manual.

1. Select a location that meets the requirements as illustrated on the guideline sheet (yellow pages located in the center of this manual). An ideal installation would provide for 25 diameters of straight pipe upstream from the meter and 10 diameters downstream.

You will also need to know the pipe internal diameter (NB) and pipe wall thickness for calculation of the insertion depth. (*refer page 5.*) Non ideal installations may require in-situ calibration (*refer to the factory for details*).

2. After screwing the Dualpulse in place ensure the flow alignment mark located on the top positioning collar of the meter aligns with the flow in the pipe (*refer page 5*). This ensures the paddle is correctly aligned to the flow.

Note: The meter is bi-directional so a flow direction arrow is not provided.

3. Calculate and adjust the height of the Dualpulse (*refer page 5*).

4. Electrical Installation depends on the model you have purchased.

If the dualpulse is fitted or supplied with a receiving instrument such as a totaliser or rate totaliser please refer to the appropriate manual and Page 10 of this manual. For pulse output meters, select the appropriate output and wire to your receiving device. (*refer pages 7 to 9*).

5. Calculate the Dualpulse K (*scale*) factor to suit the installation. For ideal installations refer to page 11 or 12 or 13 of the Dualpulse Manual. For non ideal installations the K-factor may be calculated by performing an in-situ calibration. Enter the appropriate K-factor into your receiving instrument.

1.2 Overview

Dualpulse insertion flow transducers provide a cost effective and simple means of measuring the flow of a wide range of low viscosity liquids. Installation is quick and inexpensive for pipe diameters ranging from 40mm to 900mm (1.5-36") and up to 2500mm (100") nominal bore for the Hot tap capable model DP525.

Dualpulse has a linear measuring range of 0.3~10.0 metres/sec. (1~33 ft/sec.). Minimum detectable flow velocity is 0.15 m/sec. (0.5 ft/sec.). When used in conjunction with the RT12 flow rate totaliser NLC feature the linear flow range is extended down to 0.15 m/sec. (0.5 ft/sec.) with an improved linearity.

The Dualpulse is constructed from 316 L (1.4404) stainless steel enabling use in many applications for metering water and low viscosity chemicals.

Two independent pulse outputs are standard & can directly input to a wide range of ancillary instruments, PLC's and computers. Both pulse outputs have a high level of immunity to electrical interference. Options include a reed switch.

1.3 Operating principle

Flow passes through a pipe causing the rotor to spin. Magnets installed in the rotor pass by pulse sensors within the transducer body & in turn this produces frequency outputs proportional to flow rate.


1.4 Specifications *(subject to change without notice)*

Model	490	525
Suits pipe sizes	40mm - 900mm (1.5 – 36 inches)	50mm - 2500mm (2 – 100 inches)
Flow range	0.25 - 6300 litres/sec. (4-99600 USGPM)	0.4 - 49000 litres/sec. (6-780000 USGPM)
Process connections	1.5" or 2" NPT or BSPT	2" NPT or BSPT
Velocity range	0.3 - 10 metres/sec. (1 - 33 feet/sec.)	
Linearity	typically $\pm 1.5\%$	
Repeatability	typically $\pm 0.5\%$	
Pressure (max)	80 Bar (1200PSI)	
Temperature range	-40°C to 100°C (-40°F to 212°F) – refer options	
Body material	316L stainless steel (1.4404)	
Rotor materials	PEEK rotor with graphite-PTFE impregnated PEEK bearing	
O-Ring material	VITON - options available	
(a) Voltage output (to 125°C)	1.5volt x 10 μ sec pulse width, self-generated (2 wire)	
(b) Square wave (Hall Effect)	5-24vdc, 3wire NPN open collector (20mA max. current sink)	
(c) Reed Switch (to 100°C)	30vdc max. x 20mA max. (output freq. is 1/3 std. K-factor)	
Output freq. @ max. velocity	(a & b) outputs 220~240 Hz	(c) output 73~80 Hz
Output options	Ultra high temp. coil 204°C (400°F) or non magnetic	
Transmission distance	1000 metres (3300 feet) maximum	
Wiring (standard)	5 core, screened cable, length 3 metres (10 feet)	
Protection class	IP68 submersible (Nema 6X)	
Conduit entry (terminal box)	3/8" NPT or PG9	
Shipping Weight	1.2 kg (2.7 lbs.)	1.5 kg (3.3 lbs.)

2.1 Meter location


Choose an appropriate section of horizontal or vertical pipe as per the guidelines below. With vertical pipe installations the media should be pumped up through the pipe past the flow sensor so that any entrained air will pass freely.

The DP flow sensor requires a fully developed turbulent flow profile to ensure maximum measurement accuracy and repeatability. This can be achieved by installing the DP in a straight run of pipe. We recommend at least 10 but ideally 25 straight pipe diameters upstream & at least 5 but ideally 10 pipe diameters downstream of the Dualpulse. Major obstructions such as pumps, valves or strainers will require longer straight runs before and after the Dualpulse.

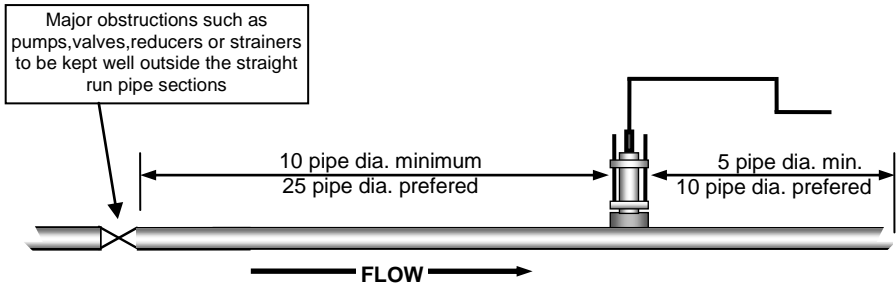

2.2 Meter installation & orientation

Cut a 40mm diameter hole (1.6") on either the 2, 10 or 12 o'clock positions of the pipe. If there is any likelihood of air entrainment in a horizontal pipe do not locate the flow transducer in the 12 o'clock position.

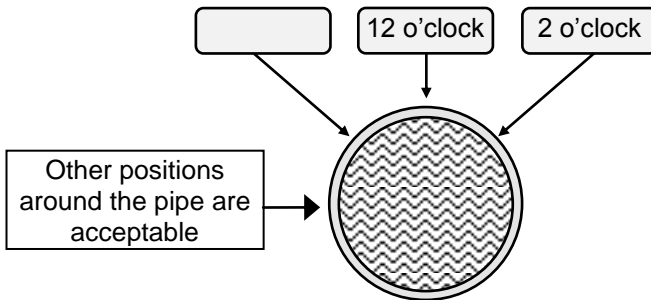

Install a female threaded weld on fitting (threadolet) or service saddle.

Wrap the threads of the Dualpulse with Teflon tape or sealing compound & screw the unit into the installed fitting.

2.5 Hot tap installation (model DP525)

Clean & lubricate screw threads before withdrawing the transducer body in order to avoid nut seizure

IMPORTANT

Before removing the DP525 from the installation first withdraw the transducer body to the maximum distance allowed by the three height adjusting threaded rods. This will enable the isolating valve to be fully closed without damaging the paddle.

If necessary extend valve port using a 2" nipple & socket combination to ensure the paddle is clear of the ball valve.

CAUTION : Hot tap installation should only be performed by qualified personal. Installation procedures should be in accordance with the safety rules, regulations and requirements applying to the territory in which the flow transducer is being installed.


2" ball or gate isolation valve.
(Allow min. 40mm I.D. to clear metering head)

2" Nipple

2" Weld-O-let
(threadolet)

Hot tap clearance hole in pipe wall to be a minimum of 40mm diameter (1.6").


FLOW

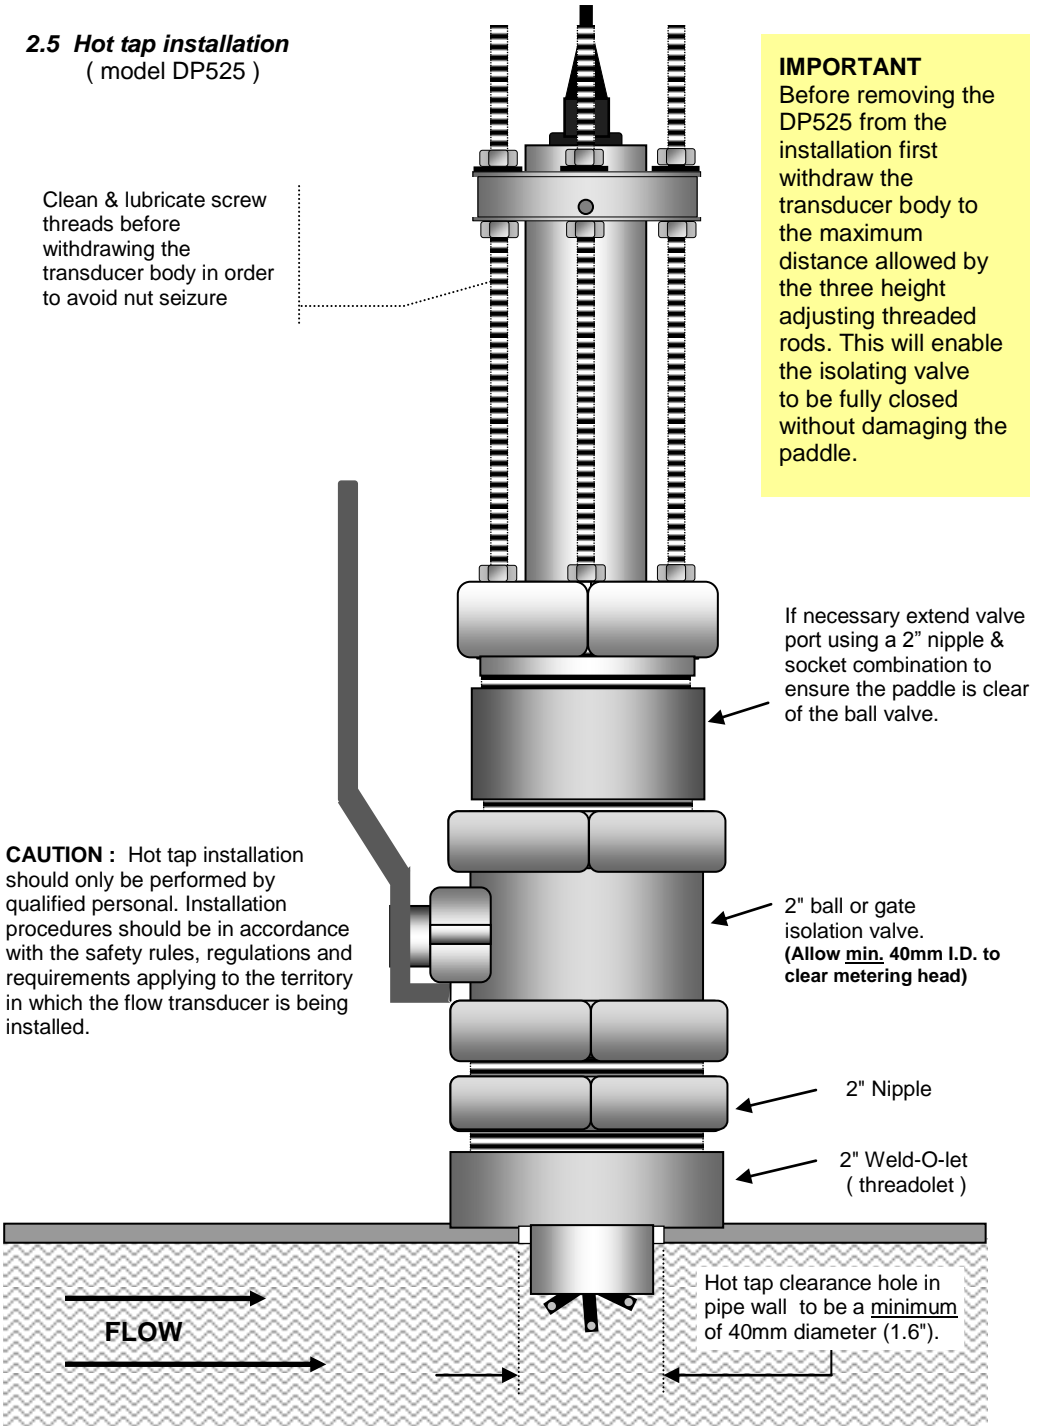

3.0 ELECTRICAL CONNECTIONS

(see page 9 for QP outputs)

3.1 Standard outputs

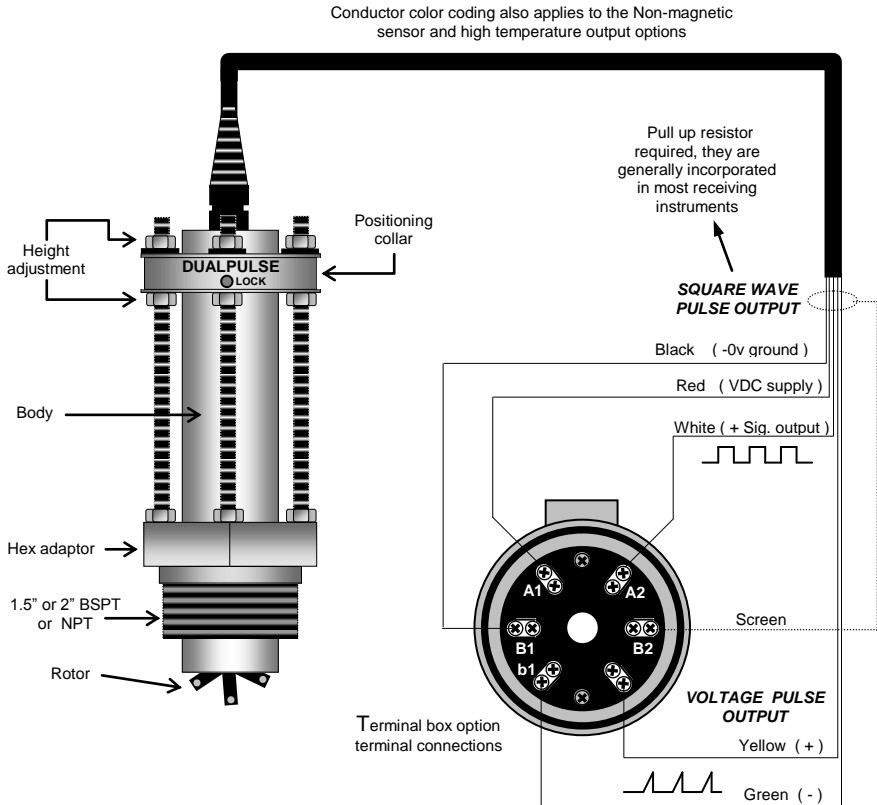


3.2 Optional Reed switch output

HAZARDOUS AREAS

The REED SWITCH output is classed as a "simple apparatus" as defined in the CENELEC standard EN50020 & recognized IEC & ATEX directive. It can be connected to an approved I.S. secondary instrument with both being located in the hazardous area. The Reed Switch may also be connected through an approved I.S. barrier.

Note: The Reed switch produces $1/3^{rd}$ the normal pulse output value (eg. $1/3$ the standard K-factor)

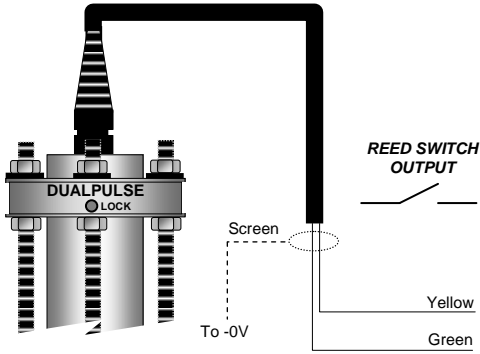

3.3 Instrument cable installation requirements

Use twisted multi-core low capacitance shielded instrument cable (22 AWG ~ 7x 0.3 stranded) for electrical connection between the flow meter and the remote instrumentation. The screen should be earthed at the readout instrument end only to protect the transmitted signal from mutual inductive interference.


The cable should **not** be run in a common conduit or parallel with power and high inductive load carrying cables as power surges may induce erroneous noise transients onto the transmitted pulse signal. Run the cable in separate conduit or with other low energy instrument cables .

3.4 Pulse output selection (standard outputs)

The standard flowmeter has two independent pulse output signals that are linearly proportional to volumetric flow rate. Pulse transmission can be up to 1000 metres (3300 ft). An optional I.S. Reed Switch output is available (see page 7).


Voltage pulse (pulse wire) output & Optional Reed Switch

A self generating pulse output which produces a strong 1.5 volt voltage spike of approximately 10 micro/second duration with no dependence on rotor speed.

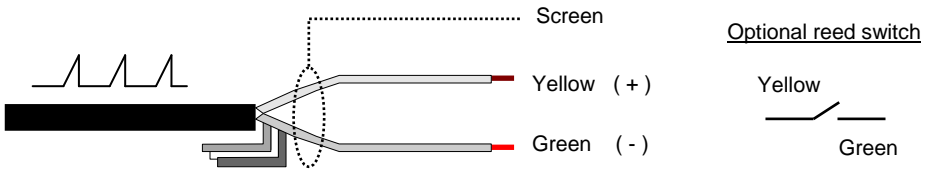


Square Wave Pulse (Hall sensor) (also applies to non-magnetic & QP Hall outputs)

An NPN open collector transistor pulse output produced by a solid state Hall Effect device. This three wire device requires 5~24vdc and produces an NPN square wave output (20mA max. sink), pulse width is 2~75 mSec. The Hall output requires a pull up resistor, these are generally incorporated in most receiving instruments. For (QP) Quadrature pulse output refer details page 9.

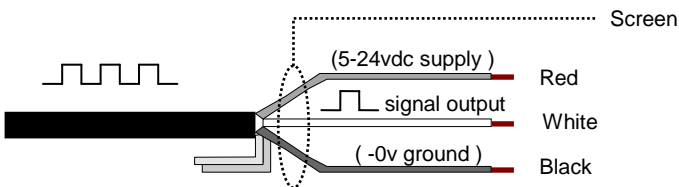

3.5 Quadrature outputs

DP series flowmeters supplied with the QP option produce two NPN open collector pulse outputs from two Hall Effect sensors. The outputs are “ phase offset ” in their timing so that external electronics are able to differentiate. These outputs may be used to assure output signal integrity or to measure bi-directional flow.

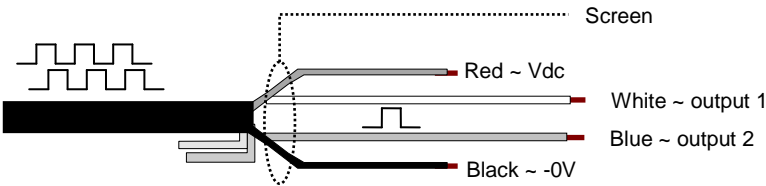


3.6 Bi-directional flow


The DP flow transducer is capable of accurately measuring flow in both directions without modification. Meters fitted with the QP output option (quadrature pulse output) may be interfaced with the Pulse Discriminator Module (PD1). The PD1 accepts the Quadrature pulse inputs & from these will discriminate between forward & reverse flow. Two individual & proportional pulse outputs can then be sent to appropriate totalising registers or an add and subtract flow rate totaliser.

It is **important to note** that the Quadrature Pulse option has the same pulse resolution (pulses/unit volume) as a standard Dualpulse for both forward & reverse outputs.

Flowmeter with QP outputs

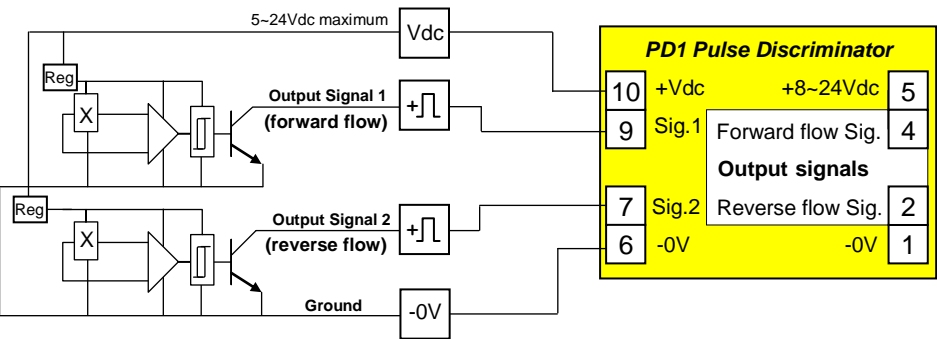

3.7 Voltage Pulse Connection to family instruments

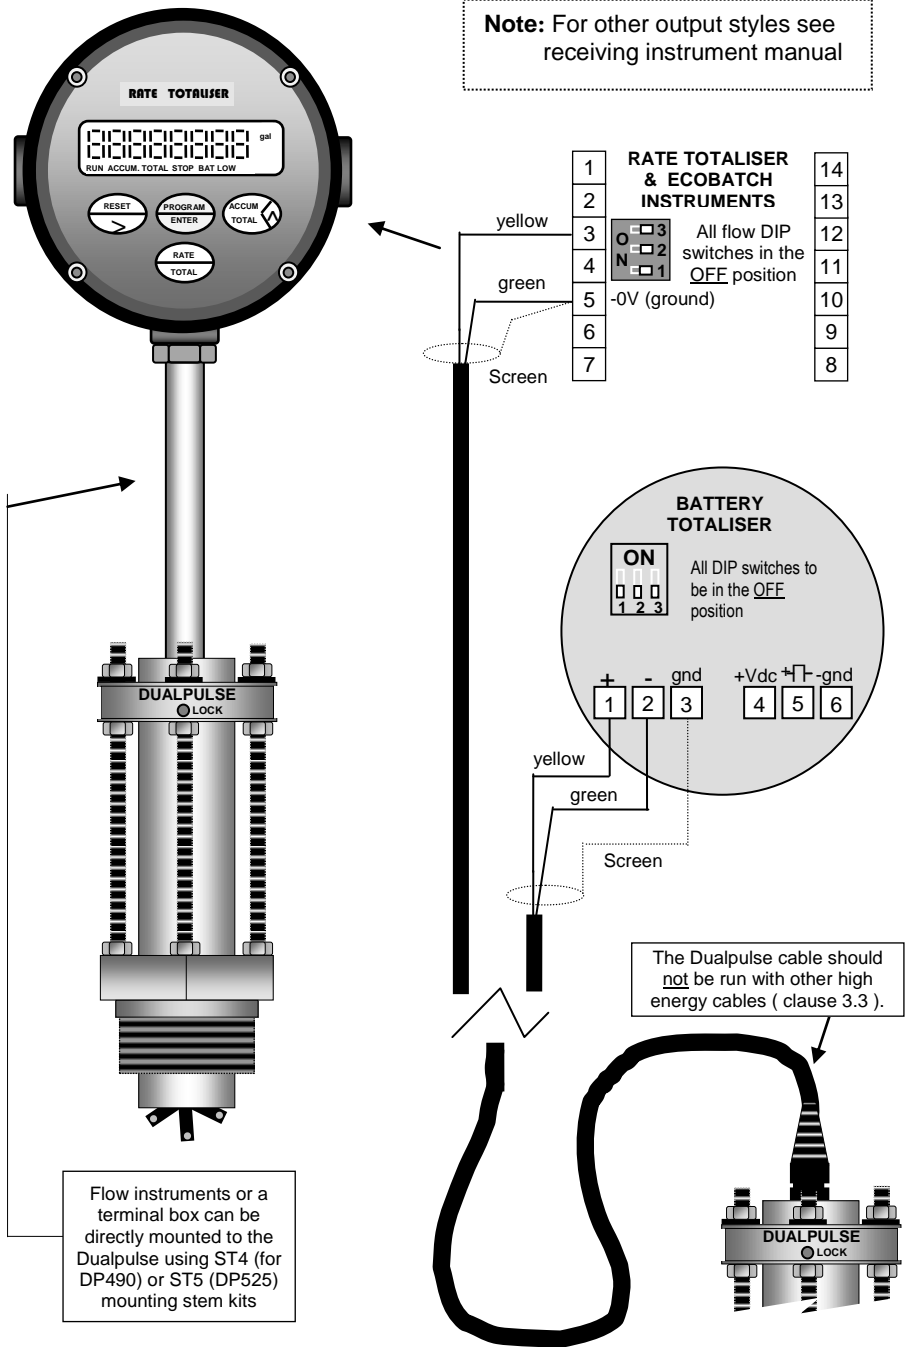

4.0 K – FACTORS (calibration factors for meter)

The K-factor (pulses / litre, gallon etc.) will vary in relation to the bore size of the pipe in which the Dualpulse is installed.

The K-factors and formula shown are a result of factory testing using smooth bore piping under ideal conditions. Variations to the given K-factors may occur when using rough bore piping or inadequate flow conditioning on either side of the flow transducer (refer clause 2.1). In these instances on site calibration may be used to determine the K-factor.

4.1 Flow transducer K- factors for common pipe sizes


Pipe detail		K-factors (standard K-factors for voltage & square wave outputs)					
NB	ID (#40)	Schedule 40 pipe - (#40)			Schedule 80 pipe - (#80)		
inches	mm	p / litre	p / m3	p / USgal	p / litre	p / m3	p / USgal
1.5"	40.9	18.678	18678	70.695	21.524	21524	81.468
2"	52.6	11.238	11238	42.534	12.818	12818	48.517
2.5"	62.7	7.880	7880	29.824	8.899	8899	33.682
3"	78.0	5.062	5062	19.161	5.676	5676	21.485
3.5"	90.2	3.768	3768	14.263	4.200	4200	15.896
4"	102	2.912	2912	11.021	3.233	3233	12.237
5"	128	1.839	1839	6.959	2.025	2025	7.665
6"	154	1.268	1268	4.798	1.402	1402	5.307
8"	203	0.719	719.0	2.721	0.787	787.2	2.980
10"	255	0.450	450.3	1.705	0.496	495.9	1.877
12"	303	0.316	316.0	1.196	0.347	347.4	1.315
14"	333	0.261	260.5	0.986	0.286	285.7	1.081
16"	381	0.198	198.0	0.750	0.217	217.0	0.821
18"	429	0.156	155.8	0.590	0.171	170.6	0.646
20"	478	0.125	125.4	0.475	0.138	137.8	0.521
24"	575	0.087	86.64	0.328	0.095	95.39	0.361

For other pipe sizes below 610mm (24") not listed above, use the graphs and apply the formula on the following pages (12 & 13).

4.2 K-factors for large pipes 460mm ID (18") and above use:

Pulses per litre	= 28647 ÷ pipe ID ² (mm)
Pulses per M³	= 28647000 ÷ pipe ID ² (mm)
Pulses per US gallon	= 168.14 ÷ pipe ID ² (inches)
Pulses per Imp. gallon	= 201.94 ÷ pipe ID ² (inches)

NOTE : K-factors for Reed Switch output option are 1/3 the standard factors of voltage pulse output.

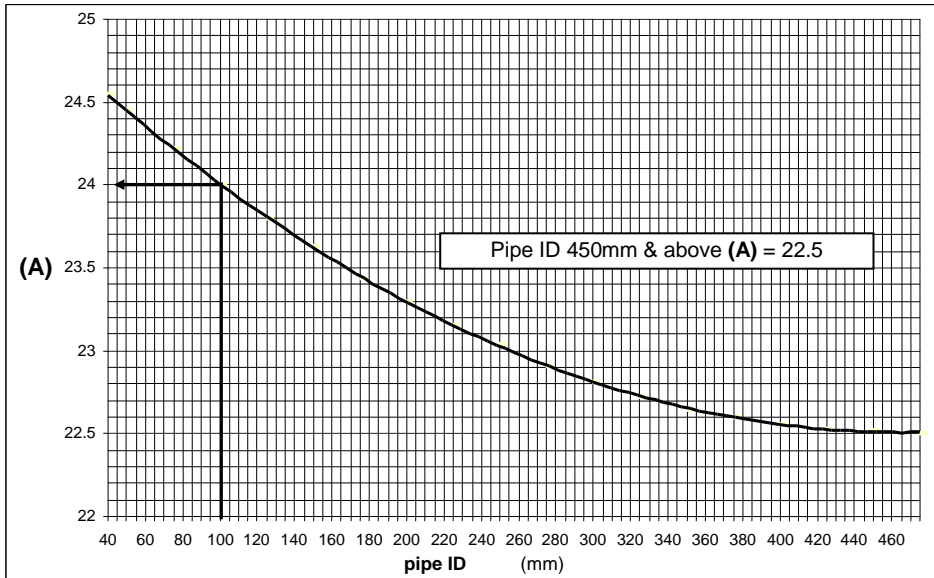4.3 Calculating K-factors (litres or m³)

Calculate K-factor (pulses / litre) using the above graph and the metric constant of 1273.2 as follows :

$$\text{Pulses / litre} = \frac{1273.2 \times (A) \text{ from graph}}{\text{pipe ID}^2 \text{ (mm)}}$$

Example 'a' :

K-factor for 100mm pipe: **1)** from graph 100mm ID (A) = 24.0


$$\text{2) pulses/litre.} = \frac{1273.2 \times 24.0}{10000} = \underline{\underline{3.056}} \text{ p/litre}$$

K-factor for m³ : multiply by 1000 eg. K = 3056 p/m³

K-factor for megalitres : multiply by 1000000 eg. K = 3056000 p/megalitre

NOTE : K-factors for Reed Switch output option are 1/3 the standard factors of voltage pulse output.

4.4 Calculating K-factors (US gallons)

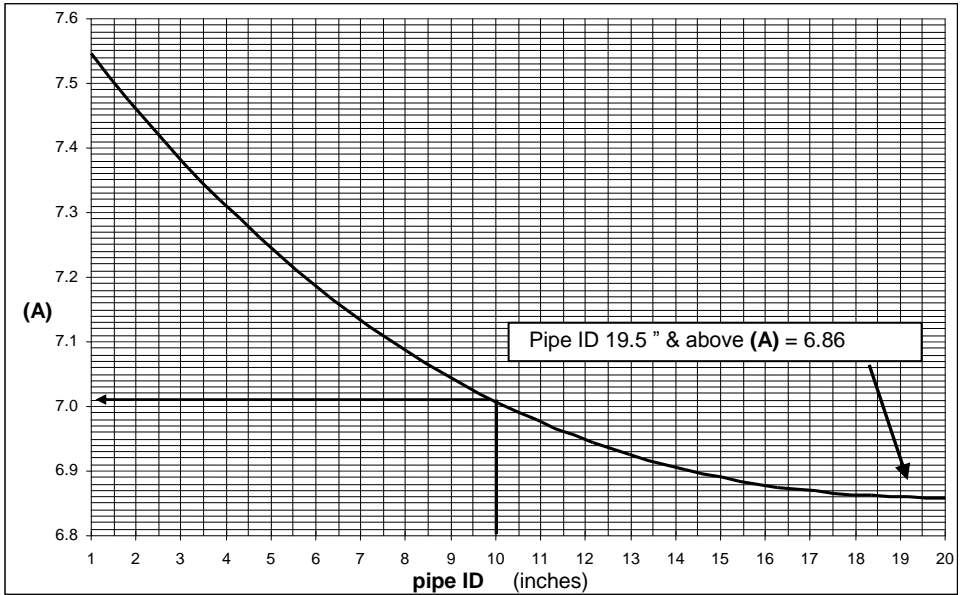

Calculate K-factor (pulses / gallon) using the above graph and the volumetric constant of 24.51 as follows :

$$\text{Pulses / US gal.} = \frac{24.51 \times (\mathbf{A}) \text{ from graph}}{\text{pipe ID}^2 \text{ (inches)}}$$

Example 'b' :

K-factor for 10" pipe: **1)** from graph 10" ID (**A**) = 7.01

$$\mathbf{2) \text{ pulses/gal.} = \frac{24.51 \times 7.01}{100} = \underline{\underline{1.718}} \text{ p/gal}}$$

NOTE : K-factors for Reed Switch output option are 1/3 the standard factors of voltage pulse output.

